


**CENTRE MEDIAN ISLAND**

**ISLAND**

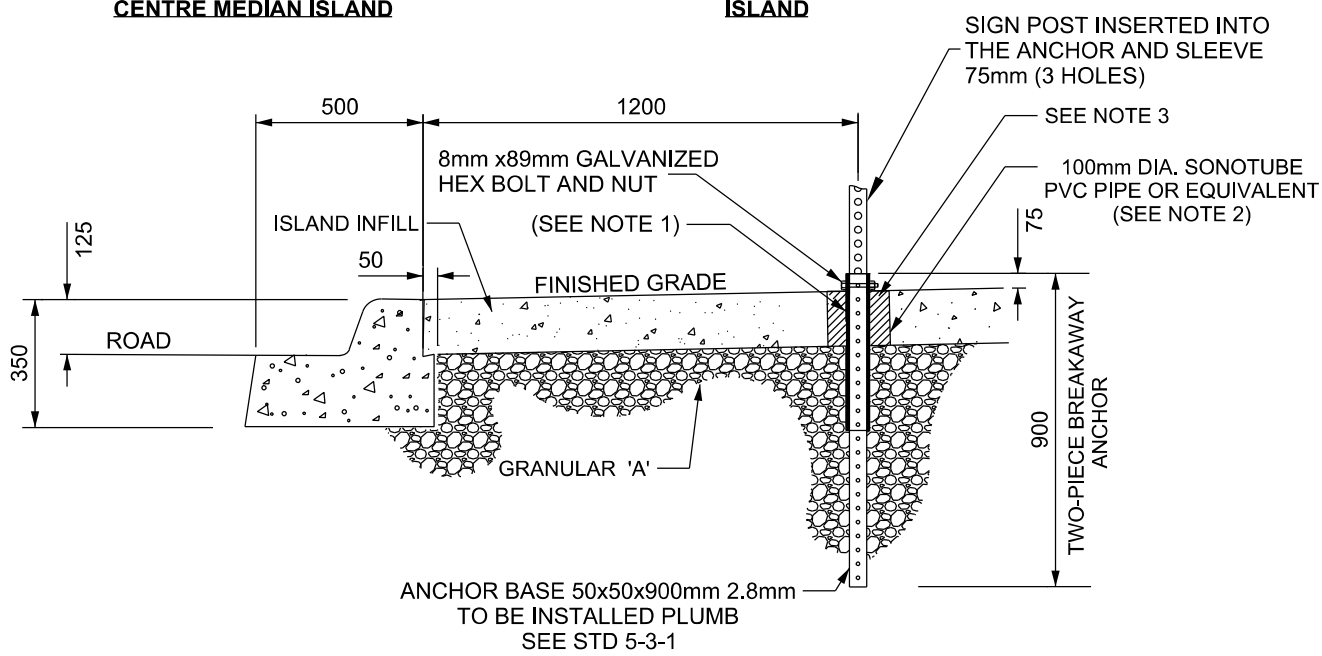

**SECTION B-B**

**NOTES**

1. ANCHOR SLEEVE 56x56x450mm 2.8mm TOP TO EXTEND 75mm ABOVE GRADE
2. 100mm DIA. SONOTUBE PVC PIPE OR EQUIVALENT MUST BE INSTALLED AT ALL CONCRETE INFILL ISLANDS, MEDIANS AND SPLASH PADS IN ACCORDANCE WITH STD. 5-3-1
3. PVC SONOTUBE VOIDS TO BE FILLED WITH LIMESTONE SCREENING AFTER SIGN INSTALLATION

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.



**PUBLIC WORKS  
STANDARD DRAWING**

DATE: MARCH 2015

APPROVED BY

DRAWN BY

G.K./S.L.

O.A.

**BULLNOSE CONCRETE CURB AND GUTTER  
AT CENTRE MEDIAN AND ISLAND**

STD. DWG. NUMBER

SCALE

**5-3-2**

N.T.S.