


# FLUSHING AND VALVE CONNECTION DETAIL ON LPSS SERVICE



**NOTE**

1. IF A CHECK VALVE IS REQUIRED, THEN ALL APPURTENANCES (VALVE, CHECK VALVE, FLUSHING PARTS) MUST BE LOCATED IN A CHAMBER (STD DRAWING 2-1-1, TYPE A & TYPE C) TO PERMIT ACCESS FOR MAINTENANCE. THE BALL VALVE MUST BE LOCATED AT THE CHAMBER CENTRE & WILL BE CONSIDERED PROPERTY LINE.
2. ALL PIPE AND FITTINGS MUST BE PVC SCH 80 OR EQUIVALENT

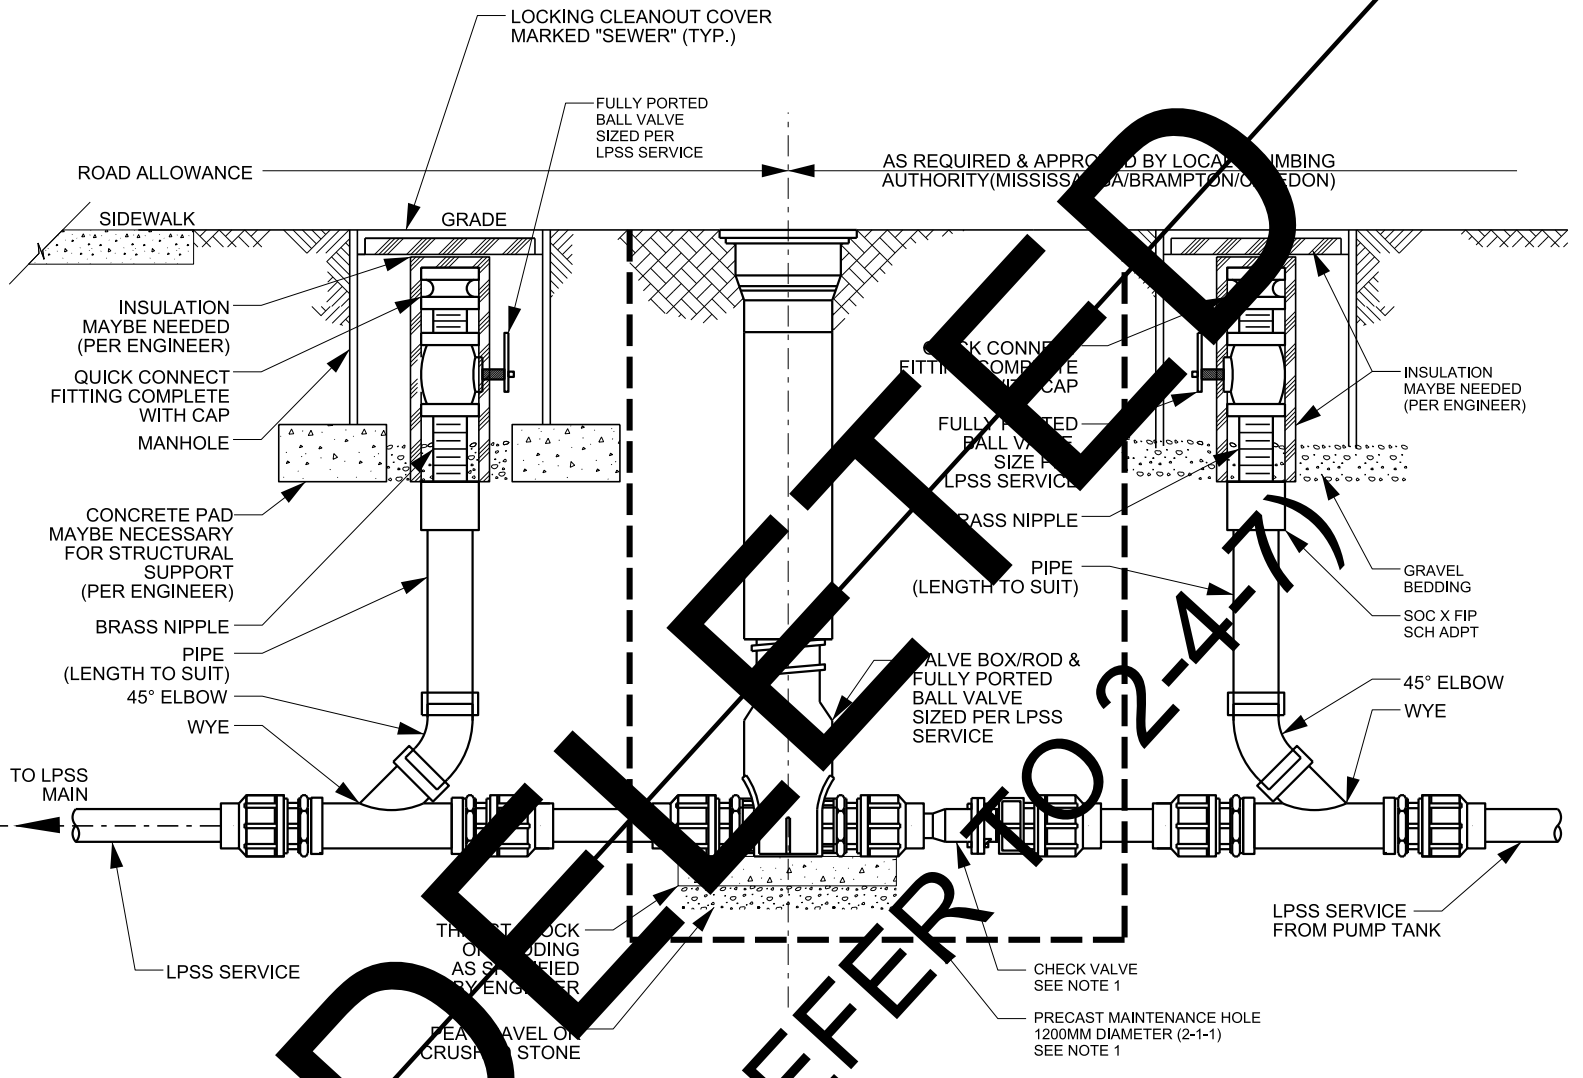

**PUBLIC WORKS  
STANDARD DRAWING**

REV. DATE: MARCH 2017

REVISION NUMBER: FOR REVISION TRACKING REFER TO STD. DWG. 2-0-2

APPROVED BY DRAWN BY

S.H. L.W.

STD. DWG. NUMBER SCALE

**2-4-5** N.T.S.

**GRINDER PUMP TO LOW PRESSURE  
SANITARY SEWER SERVICE**