


ENLARGED CONNECTION DETAIL



TYPICAL SMALL DIAMETER FLEXIBLE SEWER PIPE CONNECTION

- NOTE**
1. REFER TO STANDARD DRAWING 2-3-1 FOR BEDDING AND BACKFILL DETAILS.
 2. REFER TO STANDARD DRAWING 2-5-1 FOR GENERAL NOTES PERTAINING TO PRECAST MAINTENANCE HOLES.
 3. REFER TO STANDARD DRAWING 2-5-2, 2-5-9 FOR TYPICAL INSTALLATION OPTIONS AND REQUIREMENTS.
 4. FOR PIPE TO MAINTENANCE HOLE SIZING REFERENCE STD. DWG. 2-5-21.
 5. FOR PIPE SIZE LESS THAN 600mmØ NON PRESSURE DESIGN IS PERMITTED. PIPE SIZES EQUAL TO OR GREATER THAN 600mmØ SHALL BE DESIGNED TO PRESSURE.
 6. PIPE ENDS SHALL NOT BE SANDED OR ROUGHENED PRIOR TO INSTALLATION THROUGH WATERTIGHT SEALS.

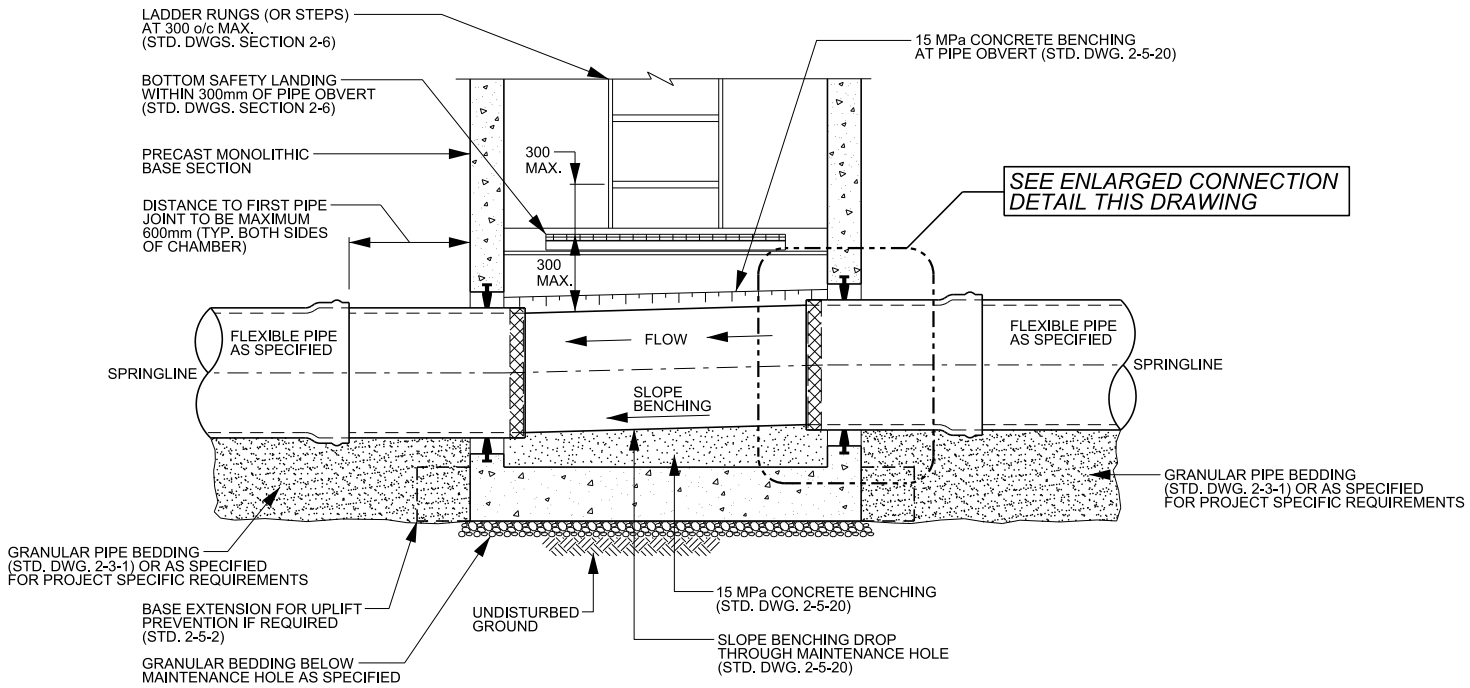

**PUBLIC WORKS
STANDARD DRAWING**

REV. DATE: AUGUST 2020

REVISION NUMBER: 2 FOR REVISION TRACKING REFER TO STD. DWG. 2-0-2

APPROVED BY DRAWN BY

A.P. AINLEY GROUP

STD. DWG. NUMBER SCALE

2-5-15 N.T.S.

**NEW SANITARY SEWER CONSTRUCTION
TYPICAL FLEXIBLE PIPE
WALL CONNECTION DETAILS**